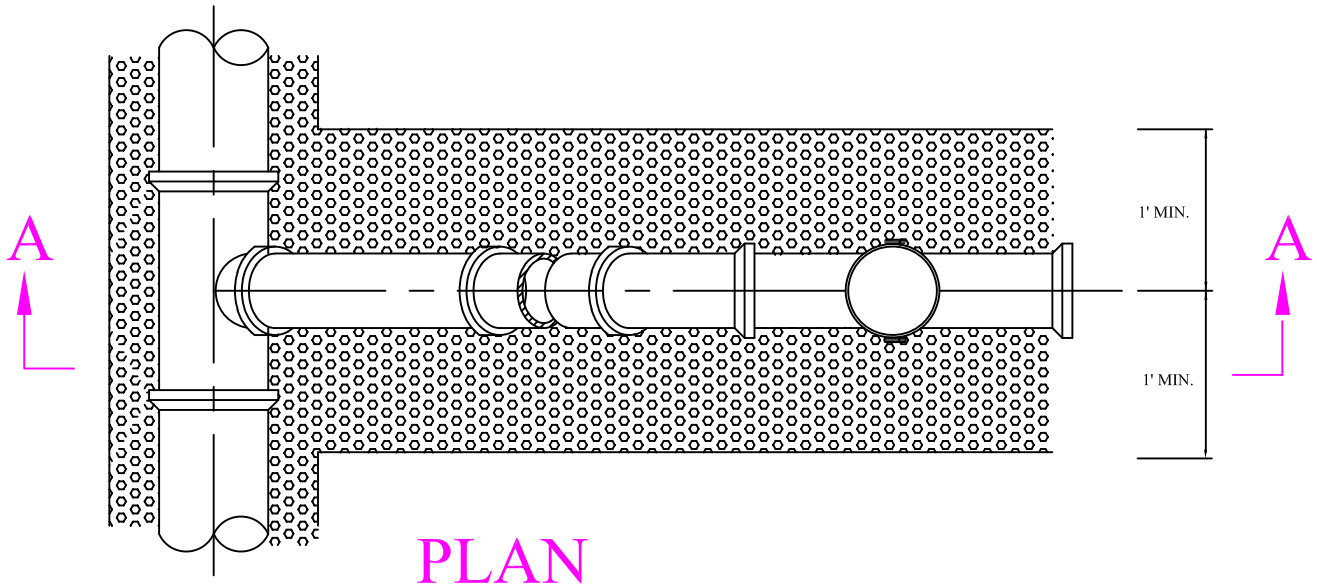

PLAN

CAP TO BE SET AT FININSHED GRADE. CAP IS TO BE AN ASTM 3034 SDR 26 (6") PVC PUSH ON CAP. GASKET SHALL BE REMOVED FROM CAP.

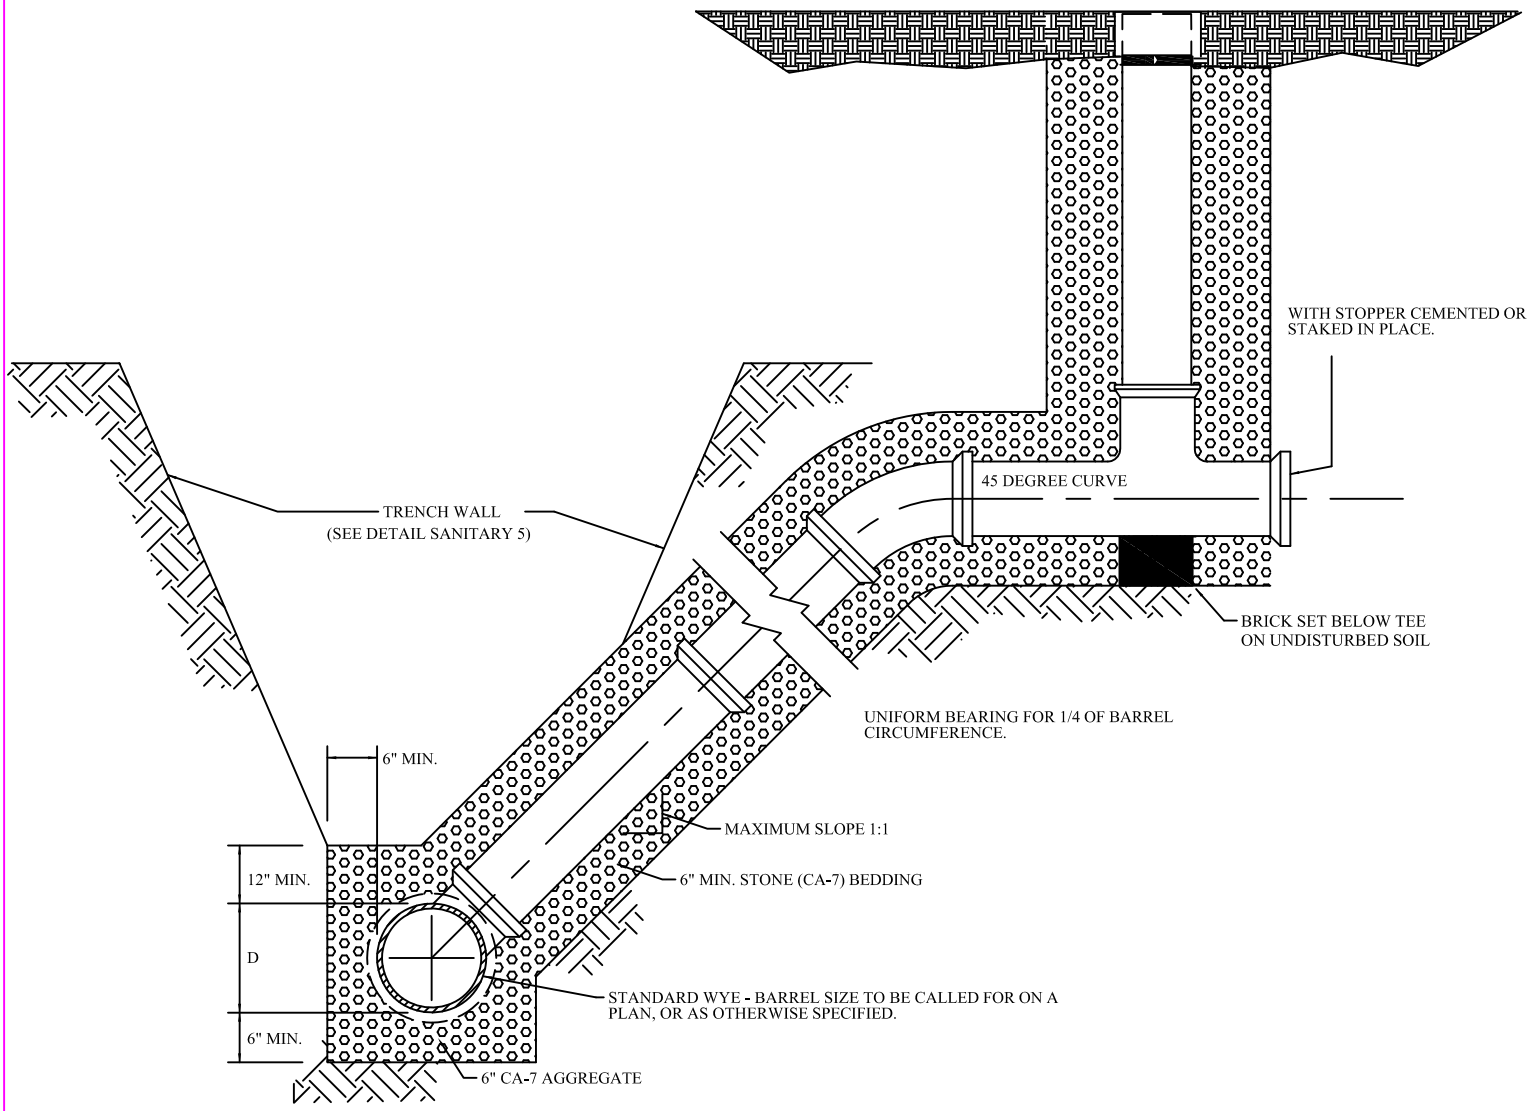

SECTION A-A

REV.:	REV.:
REV.: TEG	REV.: 02-02-2024
DRAWN BY: VJGL	DATE: 02-16-1998

RISER W/CLEANOUT SERVICE LATERAL

VILLAGE OF LOMBARD

SANITARY 4