


PAVED AREAS REFER TO NOTE 4

LANDSCAPED OR UNPAVED AREAS REFER TO NOTE 6.

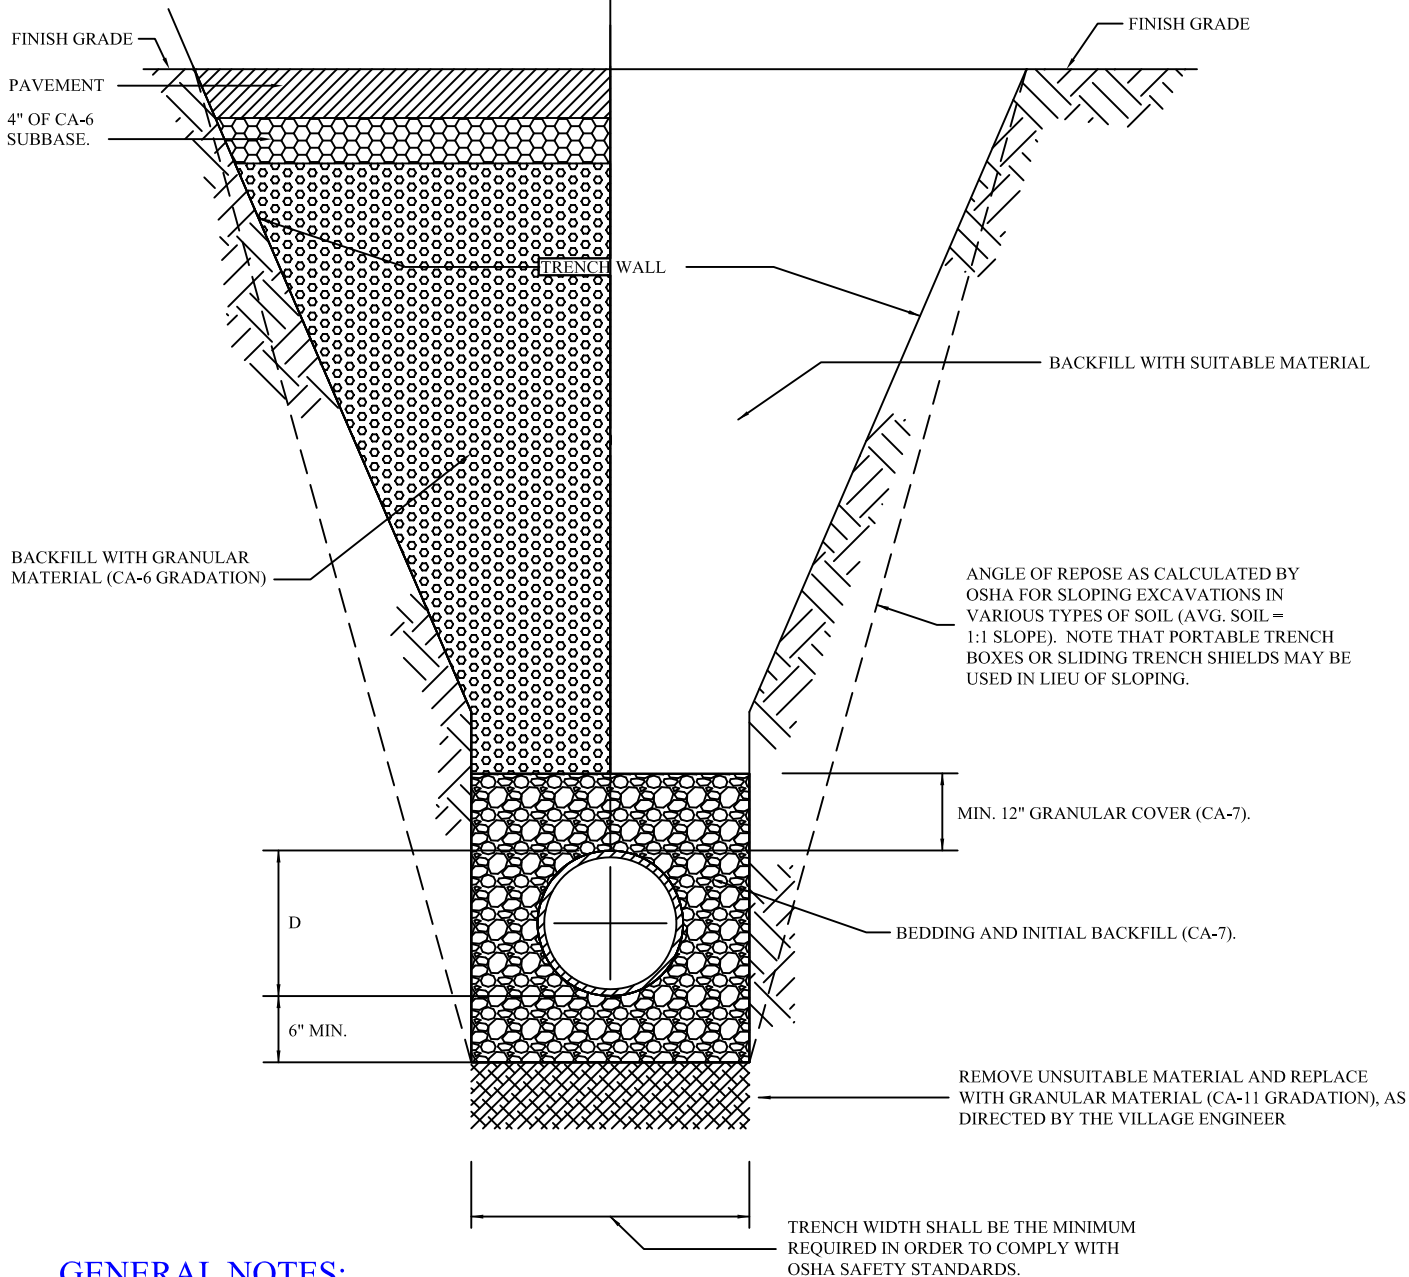

**GENERAL NOTES:**

1. CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE GOVERNING REGULATIONS, INCLUDING BUT NOT LIMITED TO OSHA SAFETY STANDARDS.
2. BEDDING THICKNESS SHALL BE A MINIMUM OF SIX (6) INCHES OR ONE QUARTER (1/4) OF THE OUTSIDE DIAMETER OF THE PIPE, WHICHEVER IS GREATER.
3. ALL BEDDING AND PIPE BACKFILL MATERIAL UP TO A HEIGHT OF 12 INCHES ABOVE THE PIPE SHALL BE CAREFULLY DEPOSITED IN UNIFORM LAYERS NOT EXCEEDING 6 INCHES THICK (LOOSE MEASURE). EACH LIFT SHALL BE COMPACTED BY MECHANICAL MEANS TO THE SATISFACTION OF THE ENGINEER.
4. UNDER PAVED AND/OR HARD SURFACES, GRANULAR BACKFILL MATERIAL (CA-6) SHALL BE PLACED AND COMPACTED AS SPECIFIED PER THE ILLINOIS DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, SECTION 550.07 METHOD 1. THE USE OF JETTING (METHOD 3) SHALL NOT BE ALLOWED UNLESS AUTHORIZED IN WRITING BY THE VILLAGE ENGINEER. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO PROVIDE APPROPRIATE JUSTIFICATION IN A WRITTEN REQUEST TO THE VILLAGE ENGINEER FOR APPROVAL OF JETTING.
5. GRANULAR MATERIAL FOR BACKFILL AND BEDDING SHALL BE GRAVEL, CRUSHED STONE MEETING THE ILLINOIS DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION FOR COURSE AGGREGATE OF THE GRADUATION SPECIFIED. NO RECYCLED CONCRETE SHALL BE ALLOWED.

REV.:	REV.:
REV.: TEG	REV.: 10-10-2024
DRAWN BY: VJGL	DATE: 02-16-1998

**SANITARY SEWER  
TRENCH SECTION**

VILLAGE OF LOMBARD
SANITARY 5

GENERAL NOTES CONT:

- 6. UNDER LANDSCAPE AREAS SUITABLE BACKFILL MATERIAL SHALL BE PLACED AND COMPACTED AS SPECIFIED IN NOTE 4. THE USE OF JETTING (METHOD 3) SHALL NOT BE ALLOWED UNLESS AUTHORIZED IN WRITING BY THE VILLAGE ENGINEER. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO PROVIDE APPROPRIATE JUSTIFICATION IN A WRITTEN REQUEST TO THE VILLAGE ENGINEER FOR APPROVAL OF JETTING.
- 7. WHEN THE INSIDE EDGE OF THE TRENCH IS WITHIN TWO (2) FEET OF THE PROPOSED OR EXISTING PAVEMENT, CURB AND GUTTER, SHOULDER, SIDEWALK OR DRIVEWAY GRANULAR MATERIAL PER NOTE 4 SHALL BE USED.
- 8. THE MINIMUM COVER OVER THE TOP OF A RIGID PIPE SHALL BE ONE (1) FOOT BELOW THE PAVED OR LANDSCAPED FINISHED GRADE. THE MINIMUM COVER OVER THE TOP OF A FLEXIBLE PIPE, UP TO AND INCLUDING FORTY-EIGHT (48) INCHES IN DIAMETER SHALL BE ONE (1) FOOT BELOW FINISHED GRADE. THE MINIMUM COVER OVER THE TOP OF A FLEXIBLE PIPE, GREATER THAN FORTY-EIGHT (48) INCHES IN DIAMETER SHALL BE EIGHTEEN (18) INCHES BELOW THE PAVED OR LANDSCAPED FINISHED GRADE.
- 9. THE MAXIMUM TRENCH WIDTH ALLOWED FOR THE PAYMENT OF BACKFILL SHALL BE 18 INCHES PLUS THE OUTSIDE DIAMETER OF THE PIPE WHEN THE TRENCH DEPTH IS LESS THAN FIVE (5) FEET FROM FINISHED GRADE TO THE PIPE INVERT OR THIRTY-SIX (36) INCHES PLUS THE OUTSIDE DIAMETER OF THE PIPE THE TRENCH DEPTH IS FIVE (5) FEET OR GREATER.

REV.:	REV.:
REV.: TEG	REV.: 02-02-2024
DRAWN BY: VJGL	DATE: 02-16-1998

**SANITARY SEWER  
TRENCH SECTION**

VILLAGE OF LOMBARD
SANITARY 5A